


- NOTES
1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPLICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
  2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION.
  3.       X UNUSED CONDUCTORS. INSULATE AND STORE.

- SYSTEM OPERATION
1. DOOR SHOWN IN THE CLOSED POSITION
  2. OPENING DOOR WILL ACTIVATE L9010-1 HORN
  3. 653-04 KEY SWITCH WILL SHUNT SYSTEM

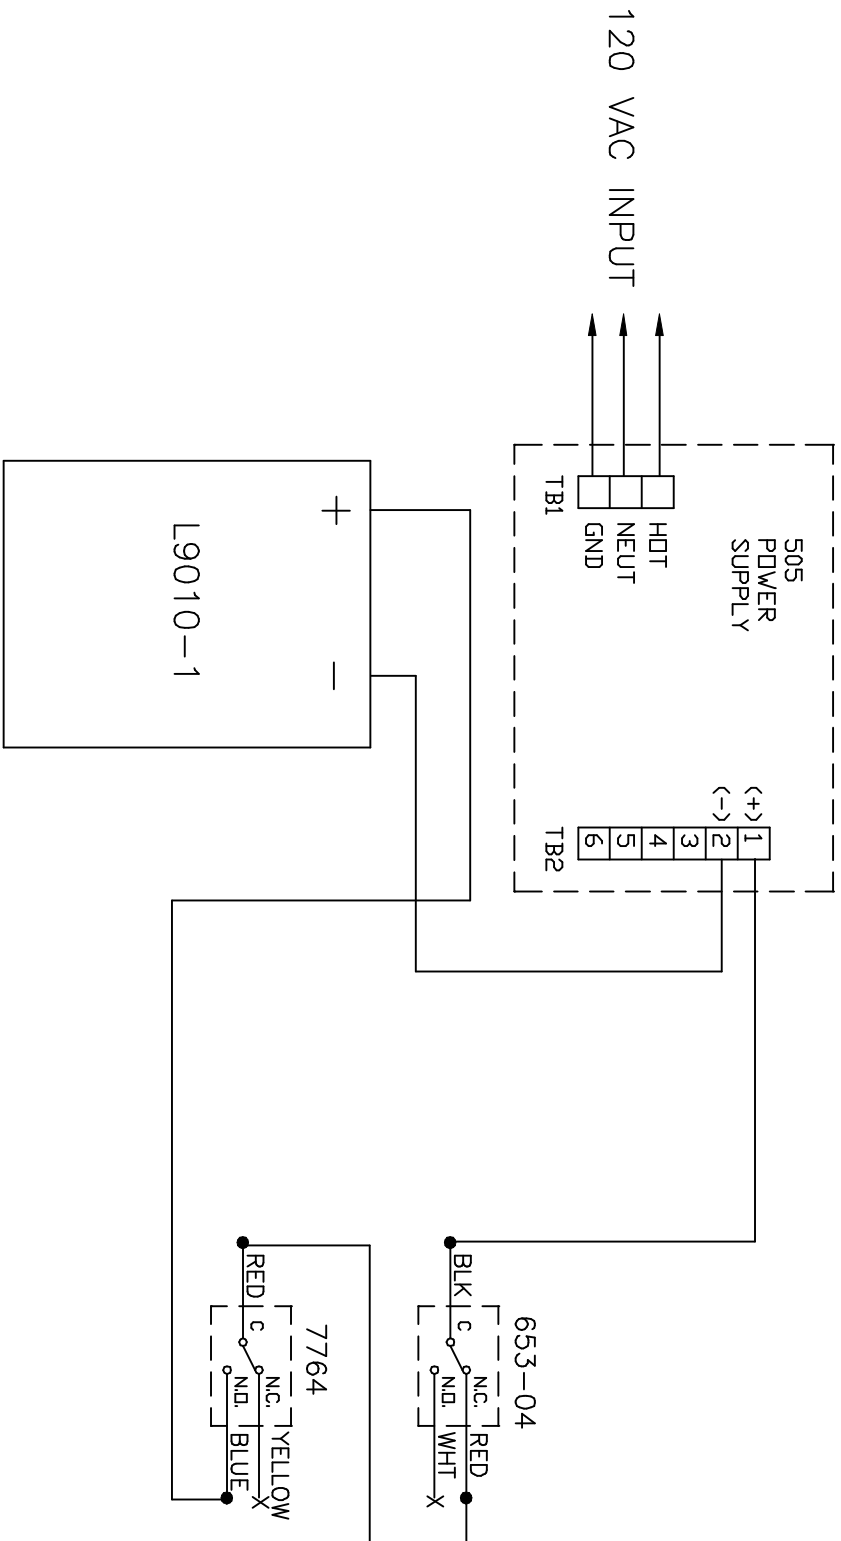

DRAWN BY: JWV  
 CHKD BY:  
 APP'D BY:

DATE 04/01  
 PROJECT NAME  
 IR-SYSTEMIZER

TITLE  
 POINT TO POINT WIRING



DWG./PROJECT NO.  
 PAGE 1 OF 1  
 REV.