


NOTES

1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION.
3. _____ X UNUSED CONDUCTORS. INSULATE AND STORE.

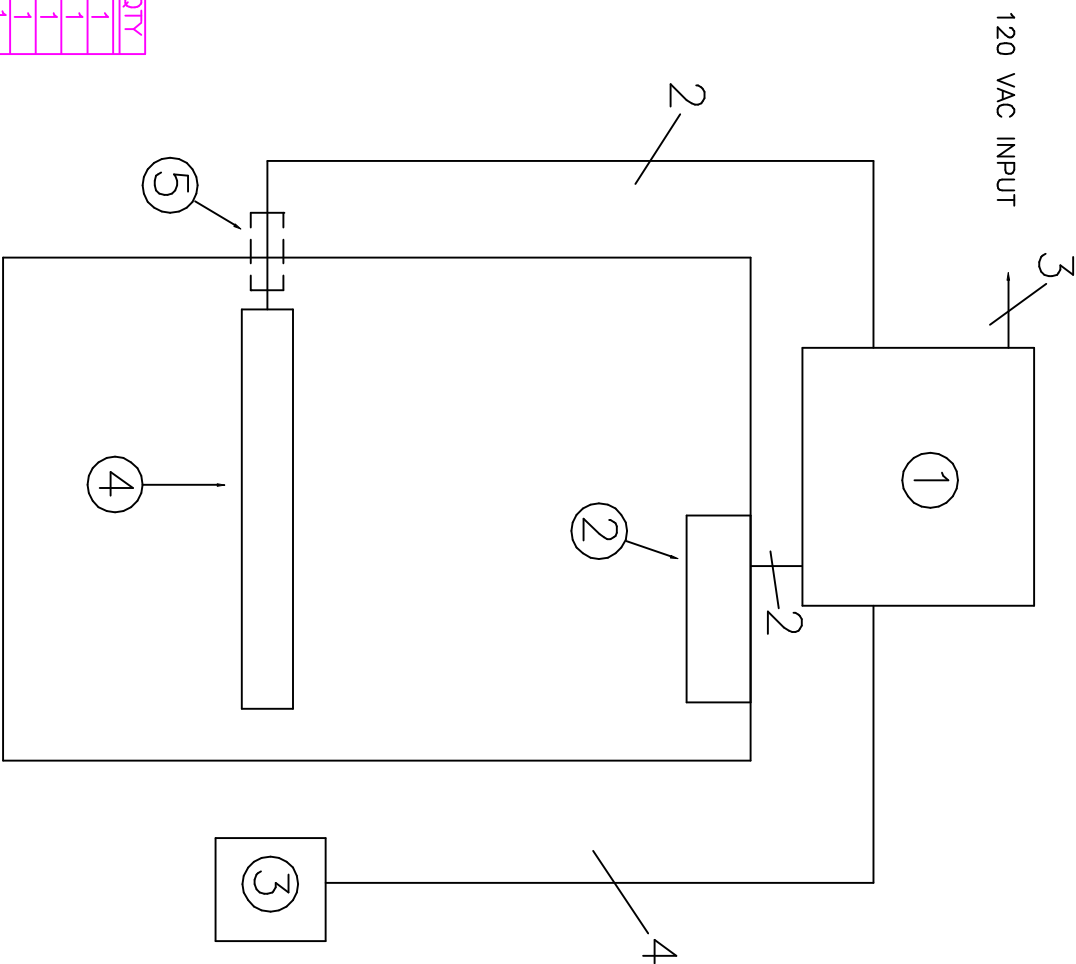

ITEM	DESCRIPTION	PART NUMBER	QTY
1	POWER SUPPLY	505 SERIES	1
2	ELECTRIC LOCK	320+	1
3	KEY PAD	PRO78	1
4	TOUCH BAR	672-36 628-RD	1
5	DOOR CORD	788-12	1
6			

DRAWN BY: JW
 CHKD BY:
 APP'D BY:

DATE 12/03
 PROJECT NAME
 IR-SYSTEMIZER

TITLE
 505 320+ PRO78 672-36
 TYPICAL RISER



DWG./PROJECT NO.
 PAGE 2 OF 2

REV.