NOTES
1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPLICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION.
3. ——X UNUSED CONDUCTORS. INSULATE AND STORE.

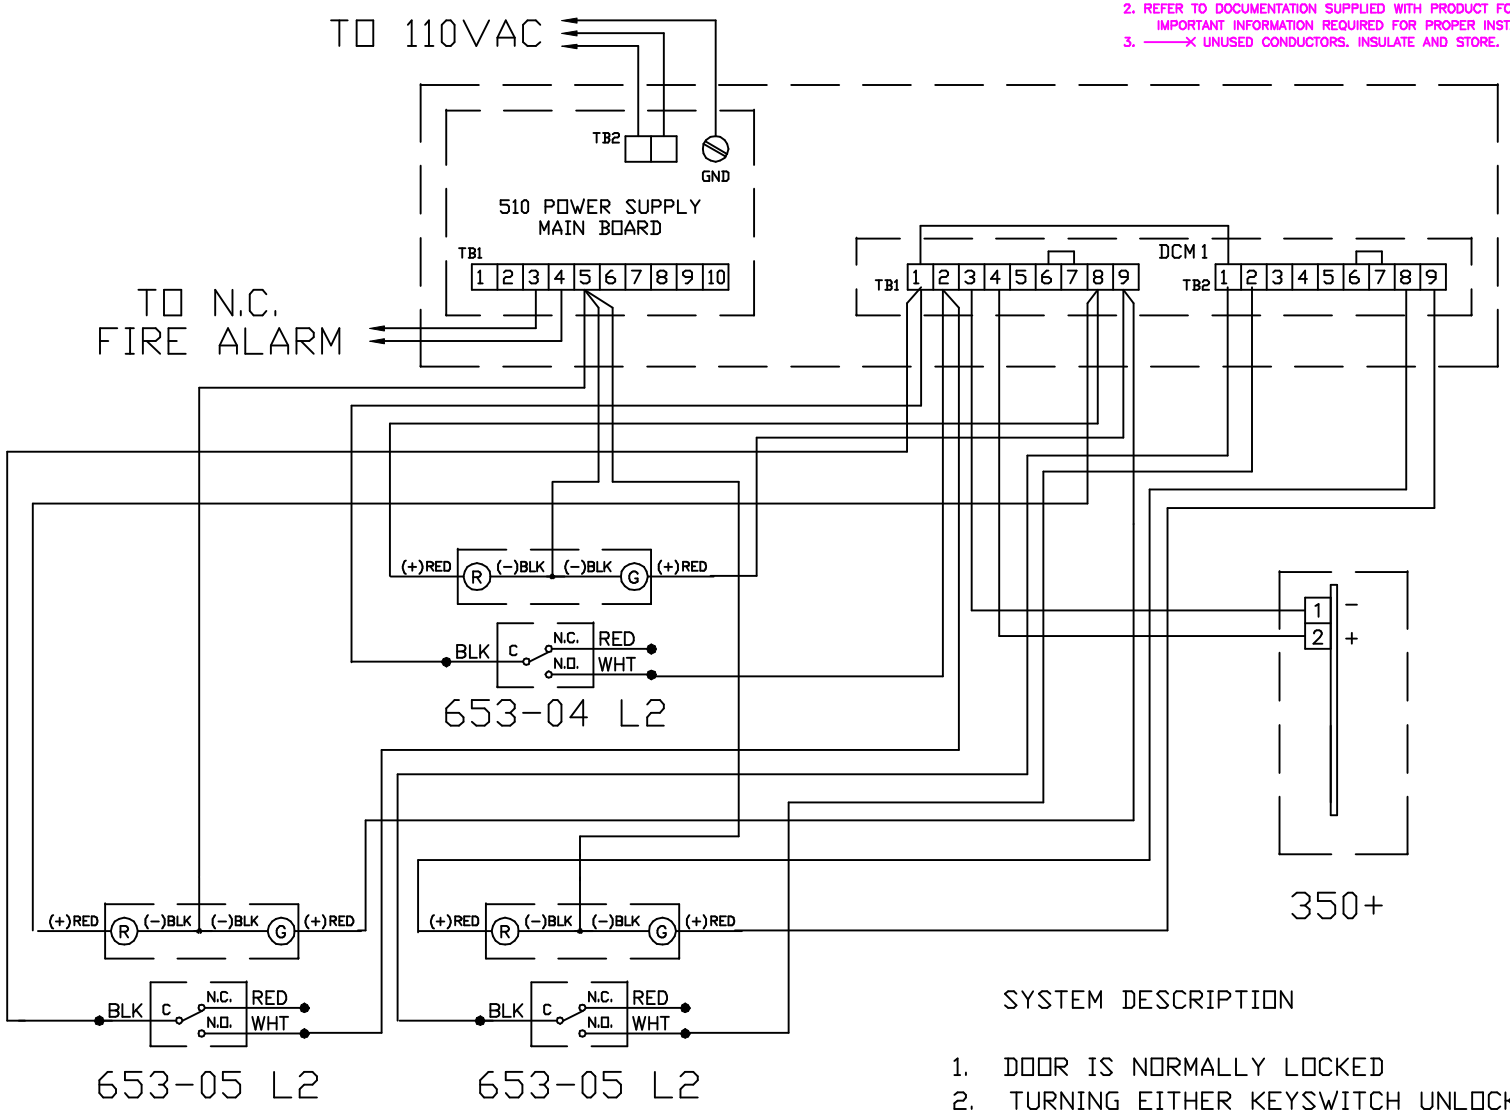

SYSTEM DESCRIPTION

1. DOOR IS NORMALLY LOCKED
2. TURNING EITHER KEYSWITCH UNLOCKS DOOR
3. WHEN DOORS ARE LOCKED, RED LED IS ILLUMINATED
   WHEN DOOR IS UNLOCKED, GREEN LED IS ILLUMINATED
4. FIRE ALARM UNLOCKS ALL DOORS, NO LEDS

DRAWN BY: SR CHKD BY: APP'D BY:	DATE 02/00	PROJECT NAME IR-SYSTEMIZER	TITLE TYPICAL WIRING DIAGRAM	LOCKNETICS Security Engineering	DWG/PROJECT NO. PAGE 1 OF 1	REV.