


- NOTES
1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPLICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
 2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION.
 3. —X UNUSED CONDUCTORS. INSULATE AND STORE.

- SYSTEM OPERATION
- SYSTEM SHOWN LOCKED AND ENERGIZED
- KEYPADS ON BOTH SIDES OF DOOR ALLOWS IMMEDIATE RELEASE OF LOCK AND ACTIVATE AUTO OPERATOR WHEN VALID CODE IS ENTERED
- ACTIVATION OF 621RDxL2xDPDT WILL RELEASE LOCK AND ACTIVATE AUTO OPERATOR. ACTIVATION OF 621RD WILL SOUND BUZZER AND LIGHT THE RED LIGHT ON DOOR #1 AND THE GREEN LIGHT ON DOOR #2
- PUSHING ON DOOR WILL ACTIVATE DELAYED ENGESS ALARM THAT WILL SOUND AT A REMOTE LOCATION FIRE ALARM WILL RELEASE ALL DOORS ON ACTIVATION

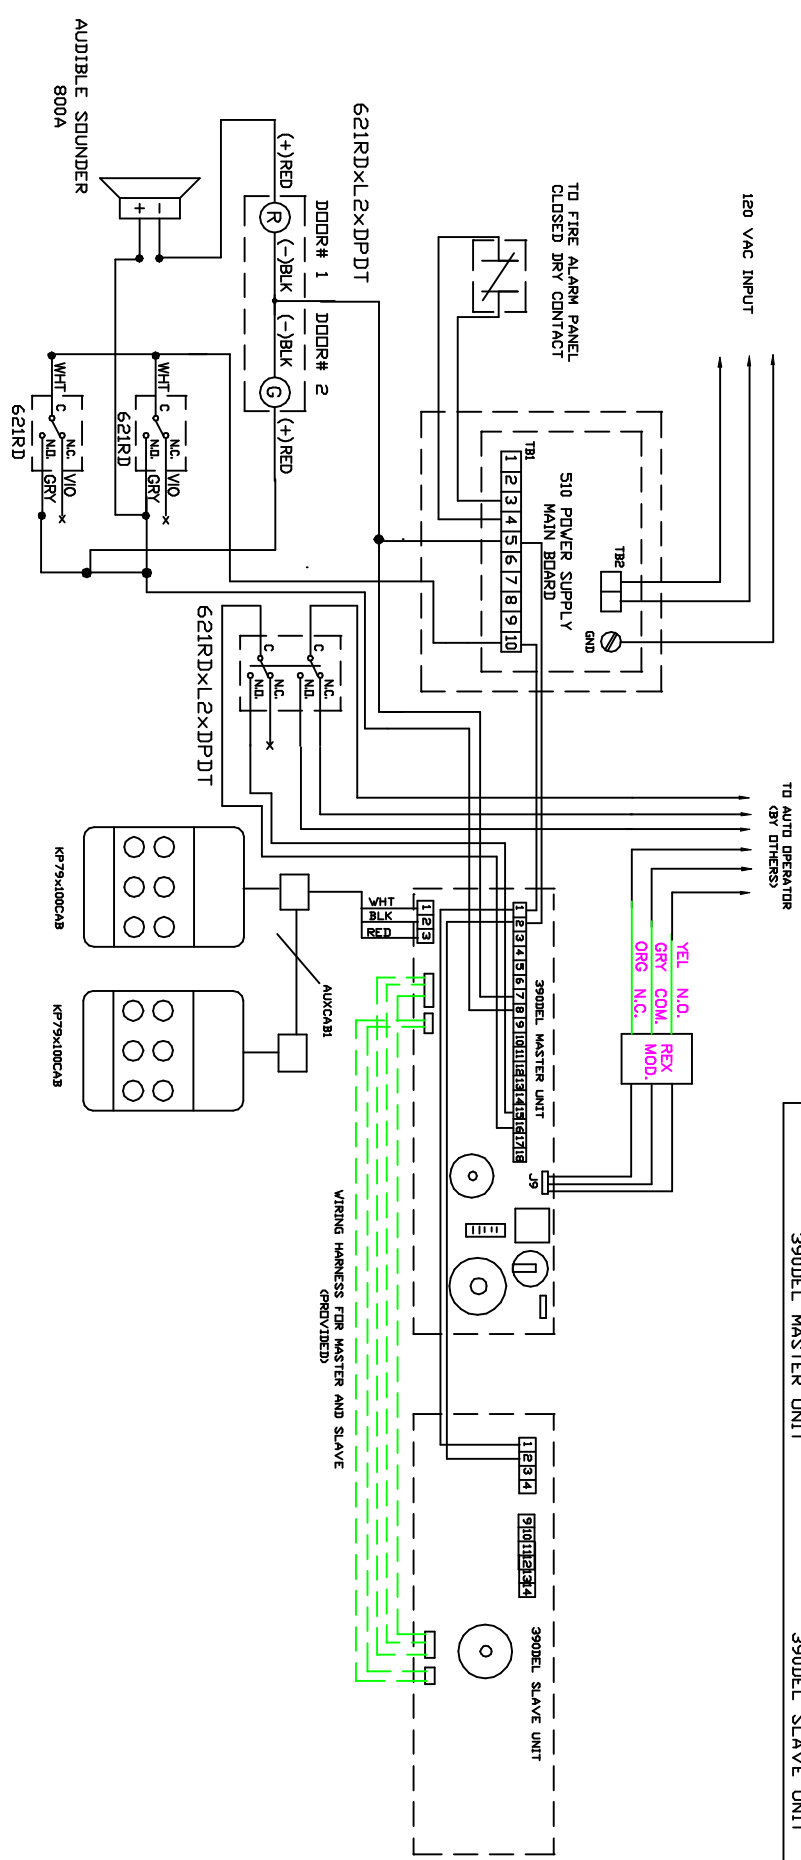

TERMINAL LAYOUT

POWER F.A. INPUT	AUX INPUT	ALARM INPUT	ISM INPUT	MBS OUTPUT	RELEASE	RESET	POWER F.A. INPUT	NO. C. NO. C. NO. C.
1	2	3	4	5	6	7	1	2
8	9	10	11	12	13	14	15	16
17	18						17	18

390DEL MASTER UNIT

POWER F.A. INPUT	NO. C. NO. C. NO. C.
1	2
3	4

390DEL SLAVE UNIT