


- NOTES
1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPLICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
 2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION.
 3. —X— UNUSED CONDUCTORS. INSULATE AND STORE.

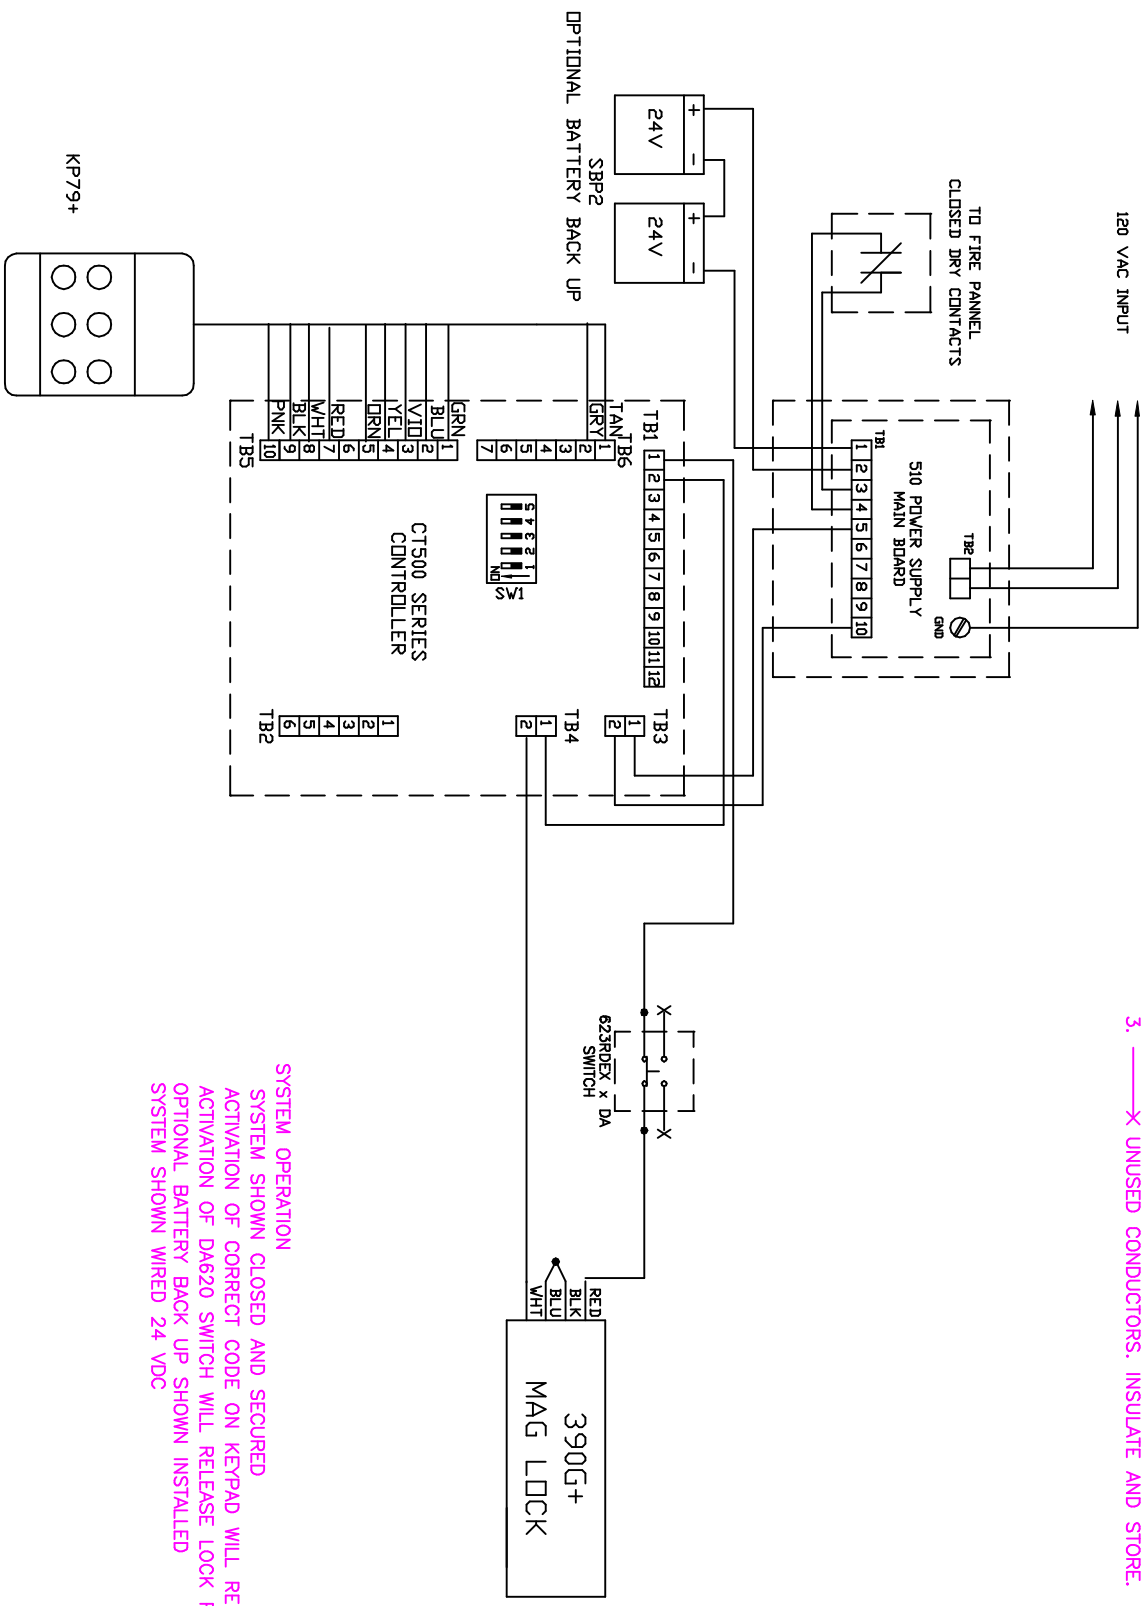

SYSTEM OPERATION
 SYSTEM SHOWN CLOSED AND SECURED
 ACTIVATION OF CORRECT CODE ON KEYPAD WILL RELEASE LOCK
 ACTIVATION OF DA620 SWITCH WILL RELEASE LOCK FOR PRESET TIME
 OPTIONAL BATTERY BACK UP SHOWN INSTALLED
 SYSTEM SHOWN WIRED 24 VDC