


SYSTEM OPERATION
 ACTIVATION OF THE 653-14 KEY SWITCH WILL DEACTIVATE LOCKS A & B AND WILL ACTIVATE LOCKS C & D
 PUSH BUTTON 631AL EX WILL TEMPORARILY UNLOCK THE PAIR OF ENERGIZED MAGNETS

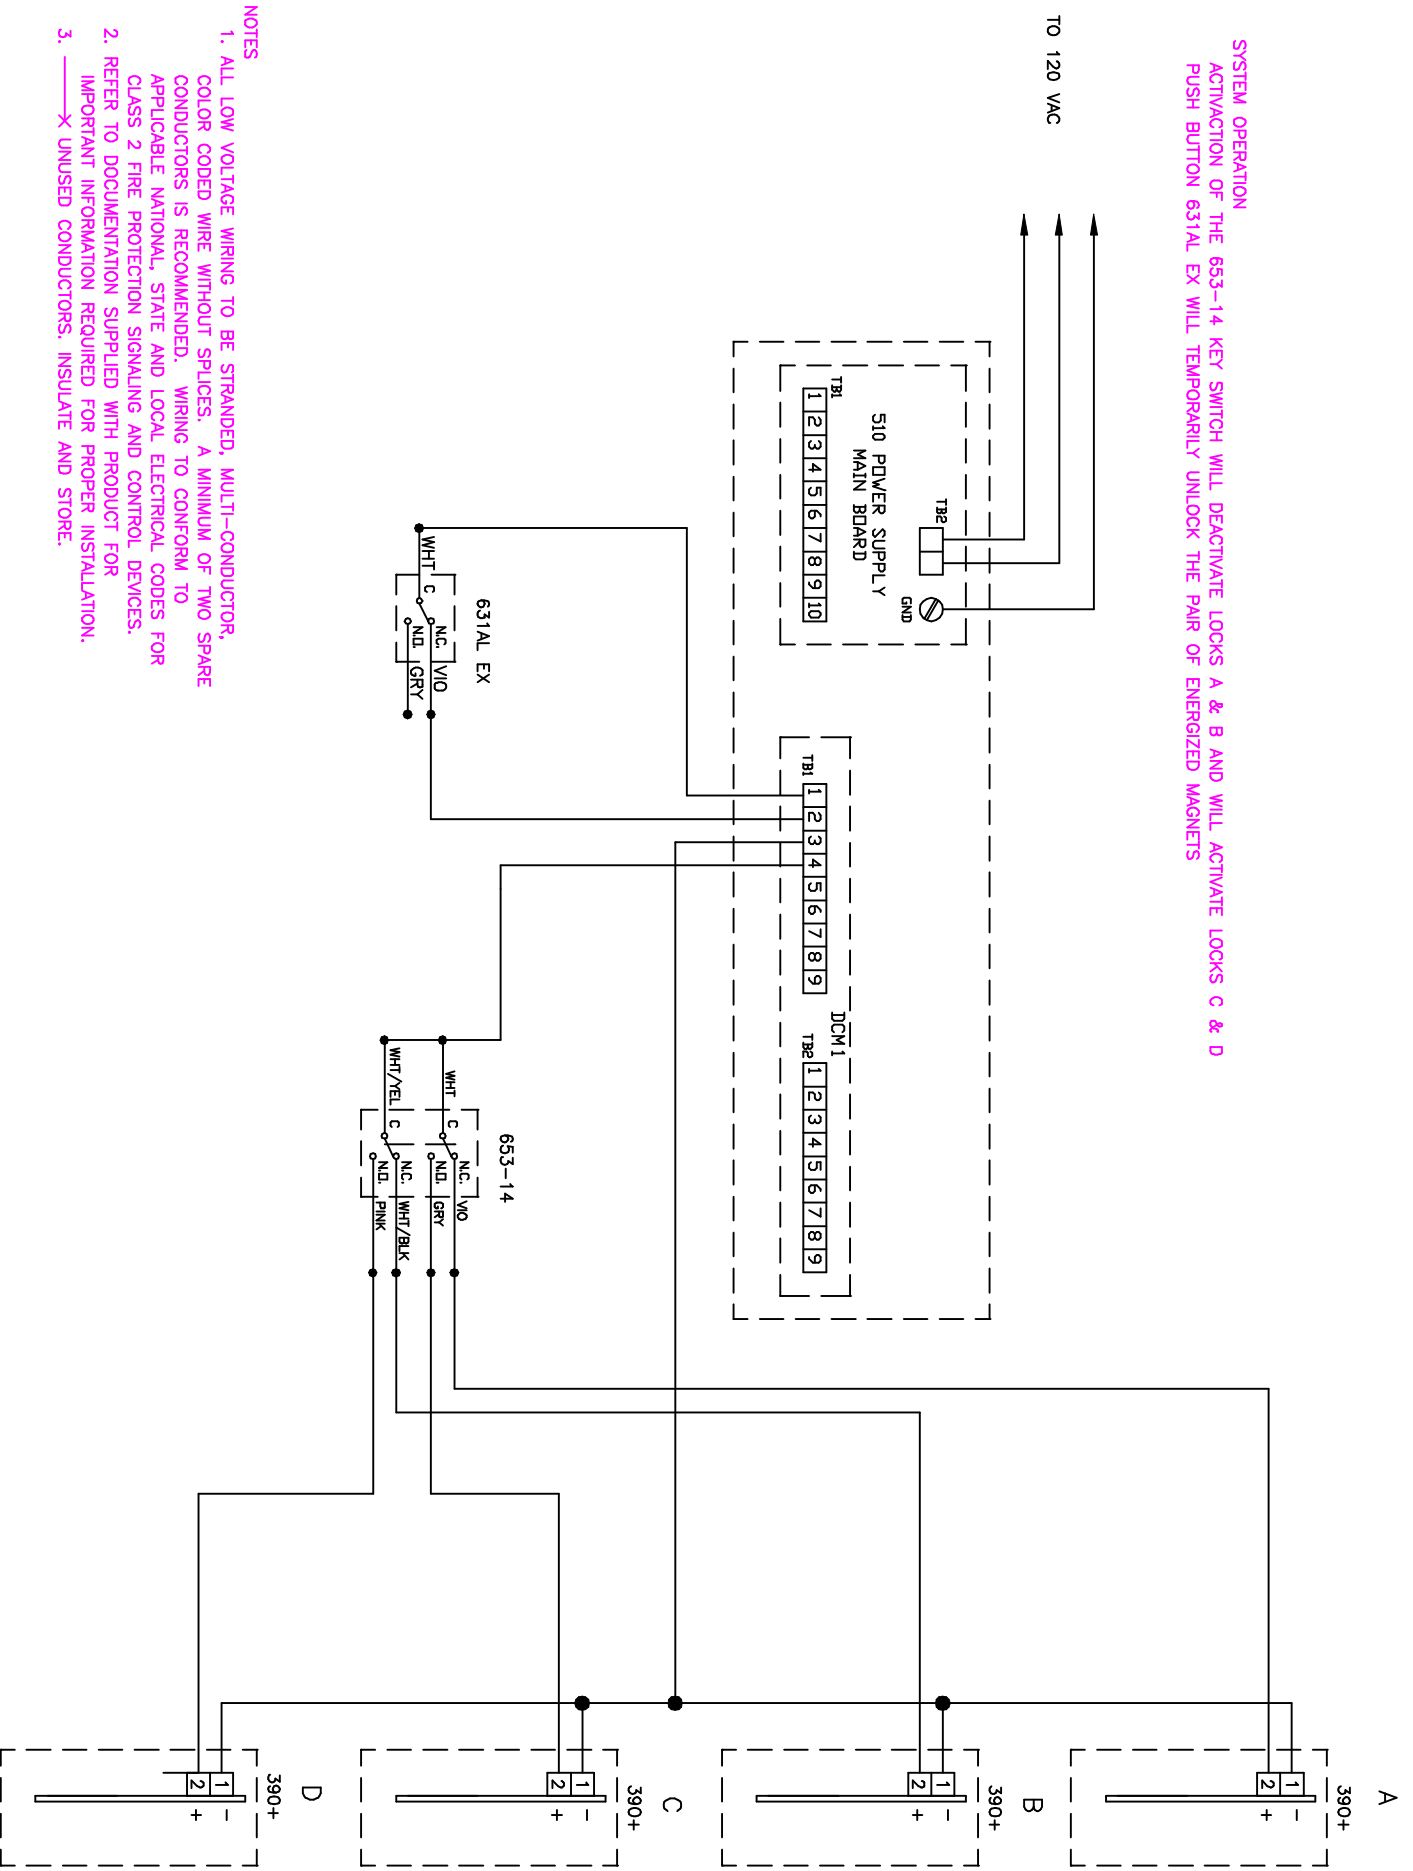

NOTES

1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPLICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION.
3. _____ X UNUSED CONDUCTORS. INSULATE AND STORE.