NOTES

1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPLICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION.
3. ——✕ UNUSED CONDUCTORS. INSULATE AND STORE.

SYSTEM OPERATION

APPLYING PROGRAMMED CARD OR CORRECT CODE OR ACTIVATION OF 620 SERIES PUSH BUTTON WILL UNLOCK LOCK AND ACTIVATE 4600 SERIES OPERATOR

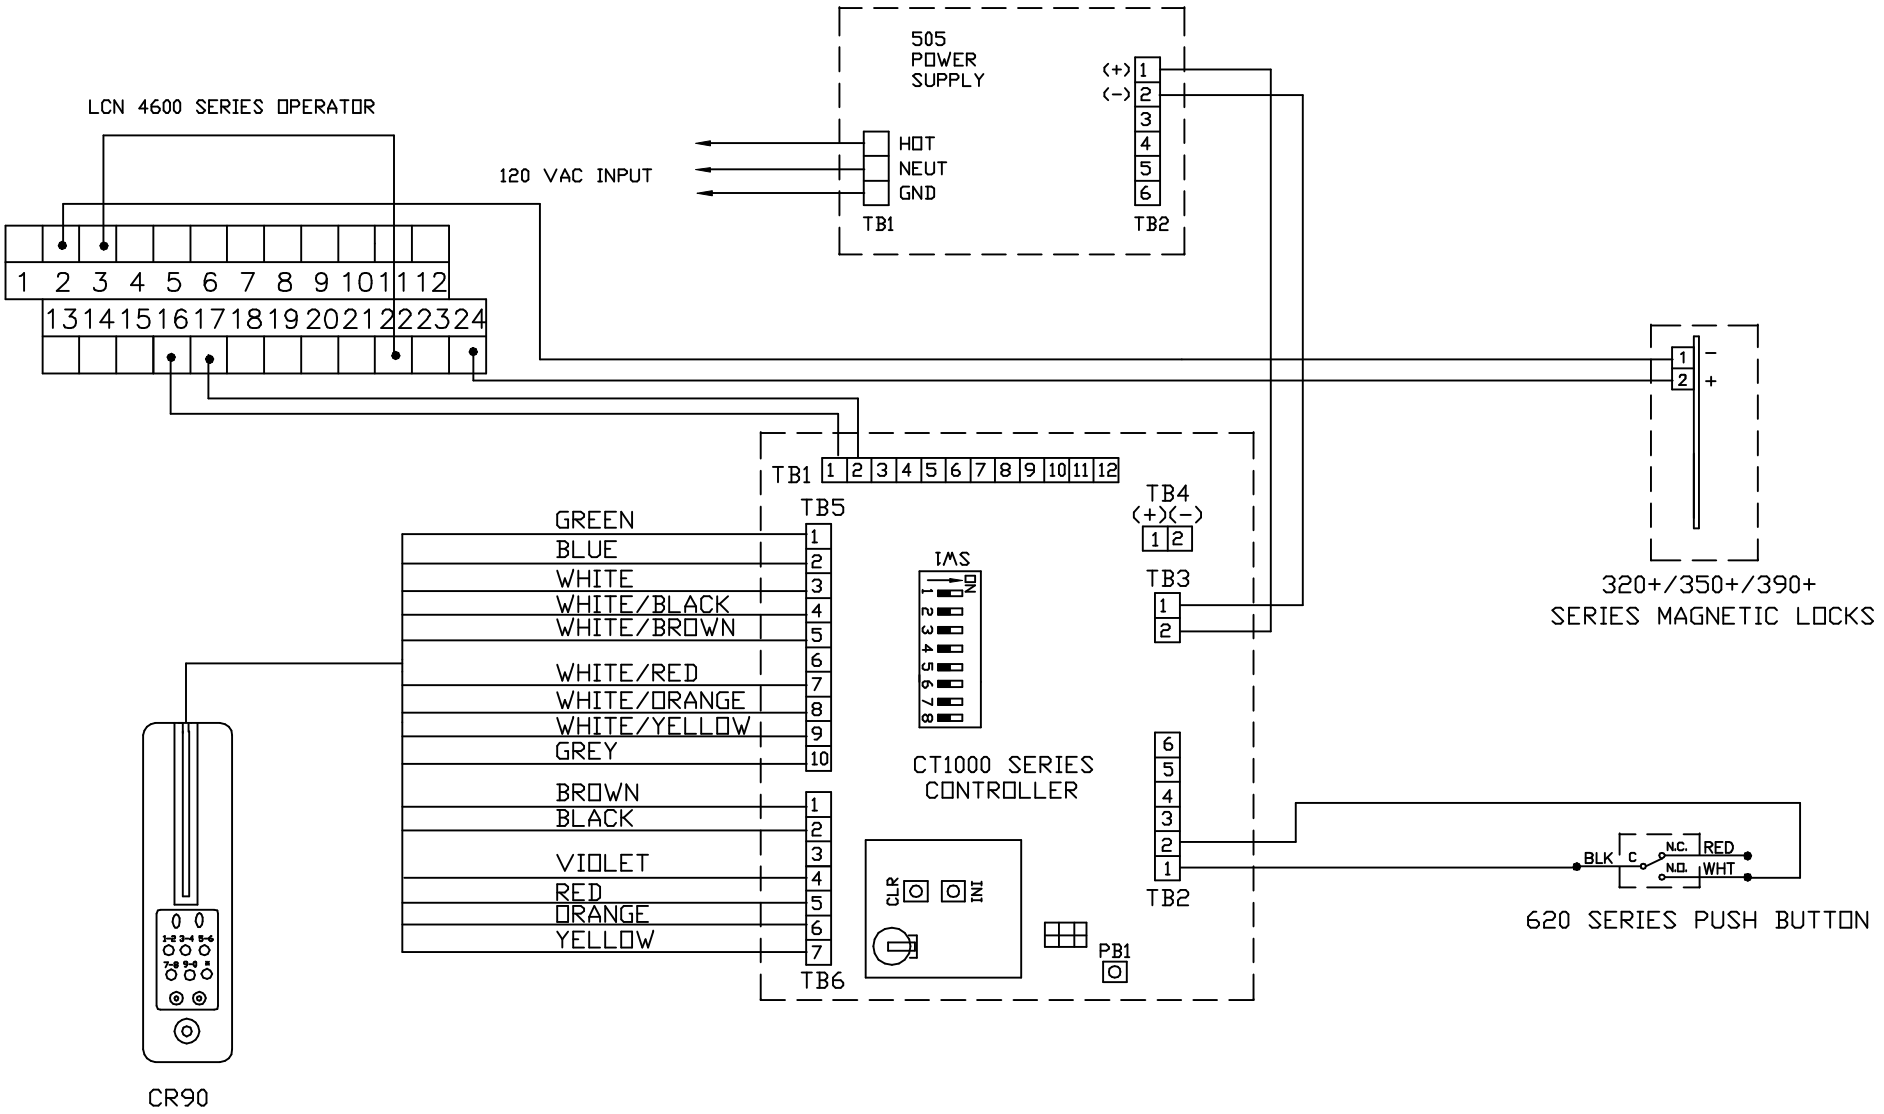

DRAWN BY: JW	DATE 8/03	PROJECT NAME	TITLE	LOCKNETICS Security Engineering	DWG/PROJECT NO.	REV.
CHKD BY:		IR SYSTEMIZER	TYPICAL WIRING			
APP'D BY:		CT1000 LCN OPERATOR MAG LOCK			PAGE 1 OF 1	