


SYSTEM OPERATION  
 SYSTEM SHOWN CLOSED AND SECURED  
 PROGRAMMED CARD TO PX95 OR CORRECT CODE ON KEY PAD  
 WILL RETRACT LATCH ON EL DEVICE  
 USE 12 AWG WIRE, 200 FEET MAXIMUM FOR OUTPUTS 01 AND 02  
 USE 18 AWG WIRE FOR CONTROL INPUTS 11 AND 12

- NOTES
1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPLICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
  2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION.
  3. —X UNUSED CONDUCTORS. INSULATE AND STORE.

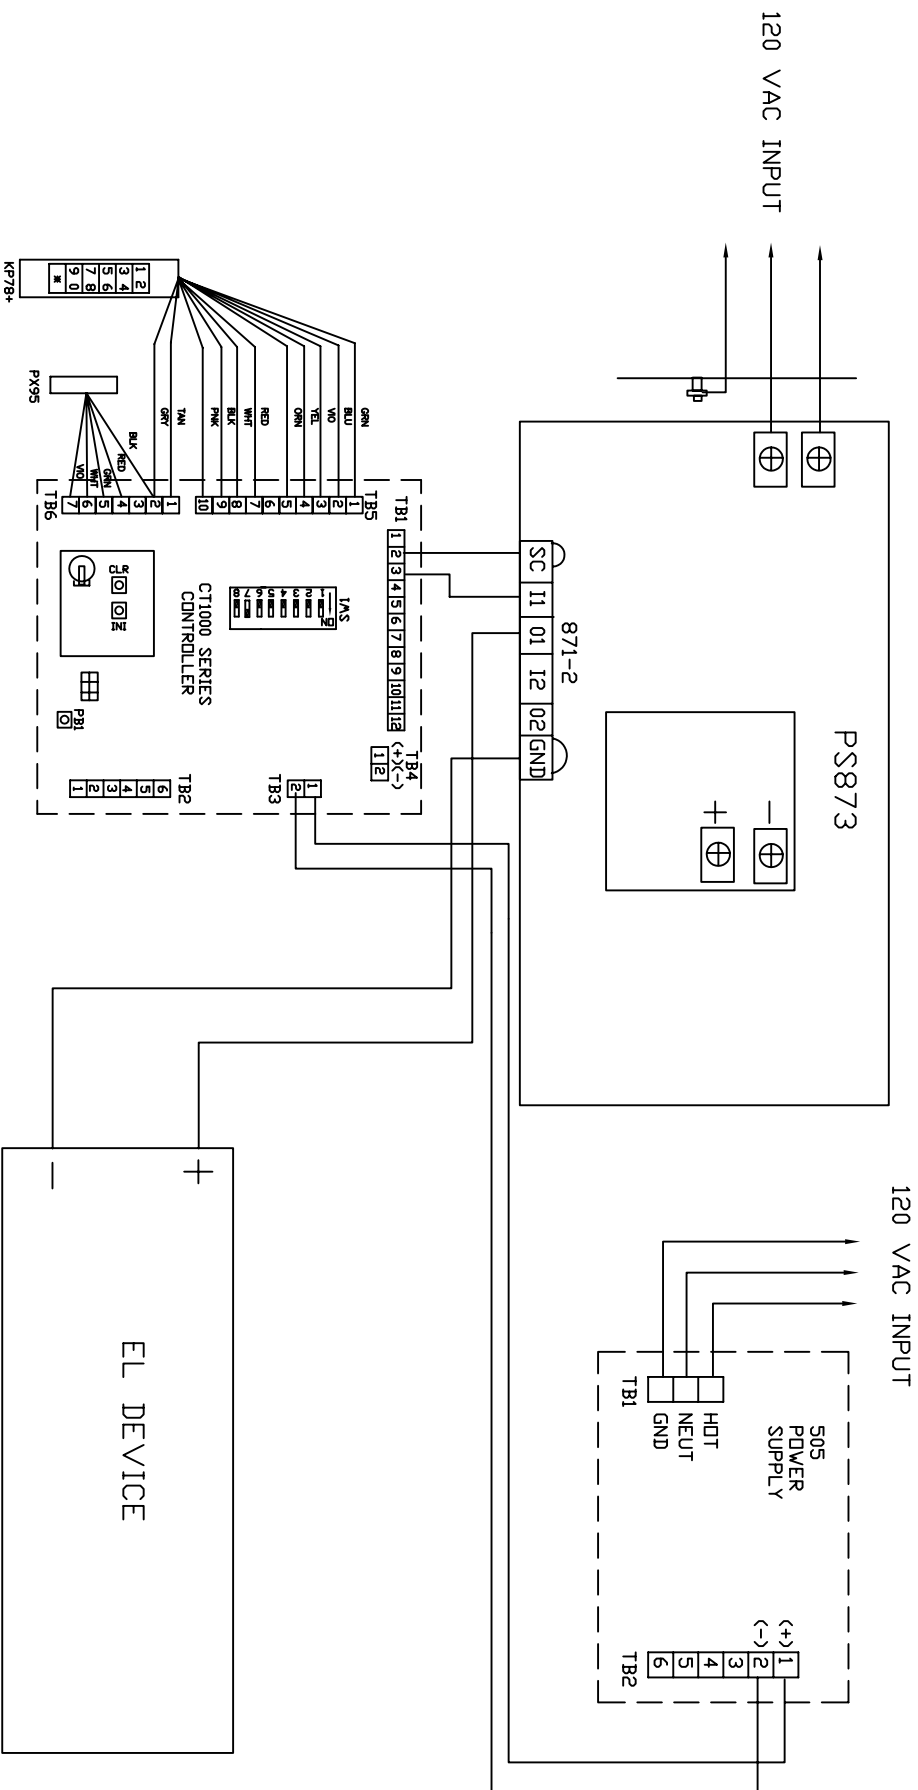

DRAWN BY: JW  
 CHKD BY:  
 APP'D BY:

DATE 9/04

PROJECT NAME

TITLE  
 TYPICAL WIRING  
 CT1000xPSS873-2xEL99

DWG/PROJECT NO.  
 PAGE 1 OF 1  
 REV.  
 1  
 1

