


HK CM (NEW STYLE)

120VAC INPUT

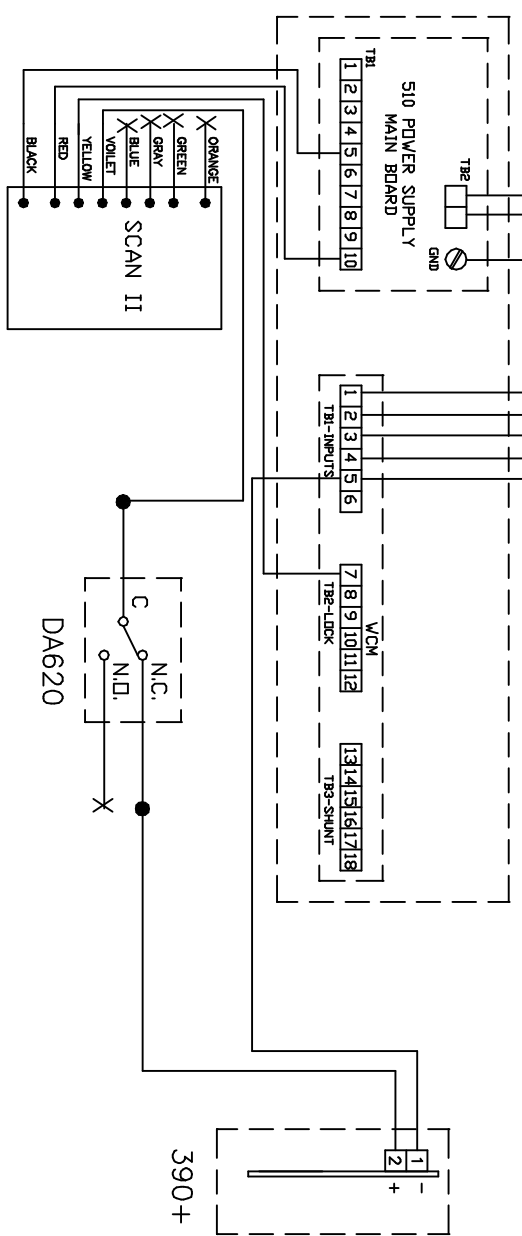

- NOTES
1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPLICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
 2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION.
 3. —X UNUSED CONDUCTORS. INSULATE AND STORE.

SYSTEM OPERATION
 SYSTEM SHOWN CLOSED AND SECURED
 ACTIVATION OF HKCM HAND READER WILL RELEASE LOCK
 MOTION DETECTOR ACTIVATION WILL RELEASE LOCK
 EMERGENCY OVER RIDE SWITCH DA620 WILL RELEASE LOCK