


NOTES

1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPLICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION.
3. — X — UNUSED CONDUCTORS. INSULATE AND STORE

SYSTEM OPERATION

SYSTEM SHOWN CLOSED AND SECURED  
 ACTIVATION OF HKCM HAND READER WILL RELEASE STRIKE  
 ACTIVATION OF D SERIES LOCKSET FROM INSIDE WILL OPEN DOOR

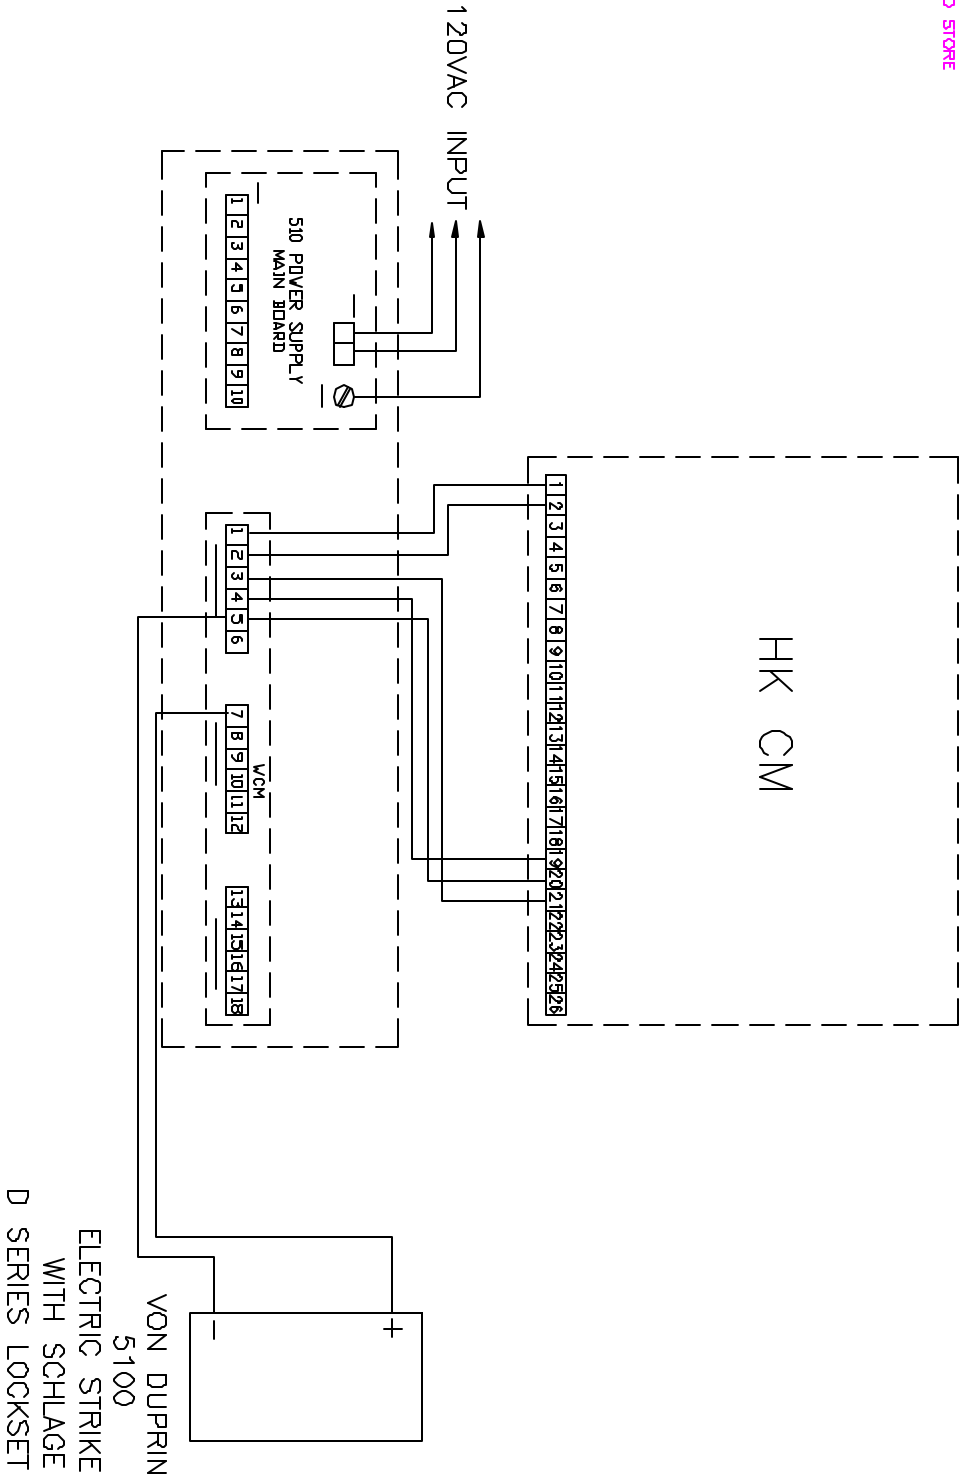

DRAWN BY: JW	DATE 10/02	PROJECT NAME	TITLE	DWG./PROJECT NO.	REV.
CHKD BY:		LOCKNETICS	HKCM WIRING	SYSTEM 2	
APP'D BY:		TECHNICAL SERVICES		PAGE 1 OF 1	

