


NOTES

1. ALL LOW VOLTAGE WIRING TO BE STRANDED, MULTI-CONDUCTOR, COLOR CODED WIRE WITHOUT SPLICES. A MINIMUM OF TWO SPARE CONDUCTORS IS RECOMMENDED. WIRING TO CONFORM TO APPLICABLE NATIONAL, STATE AND LOCAL ELECTRICAL CODES FOR CLASS 2 FIRE PROTECTION SIGNALING AND CONTROL DEVICES.
2. REFER TO DOCUMENTATION SUPPLIED WITH PRODUCT FOR IMPORTANT INFORMATION REQUIRED FOR PROPER INSTALLATION
3. X UNUSED CONDUCTORS. INSULATE AND STORE
4. USE #12 GAUGE WIRE FOR RED & BLACK CX POWER WIRES
200 FEET MAXIMUM WIRE RUN #14 GAUGE TO 100 FEET

SYSTEM OPERATION
CR90 TO RELEASE CX DEVICE FOR AUTHORIZED PASSAGE
FIRE ALARM TO RELEASE IMMEDIATE EGRESS

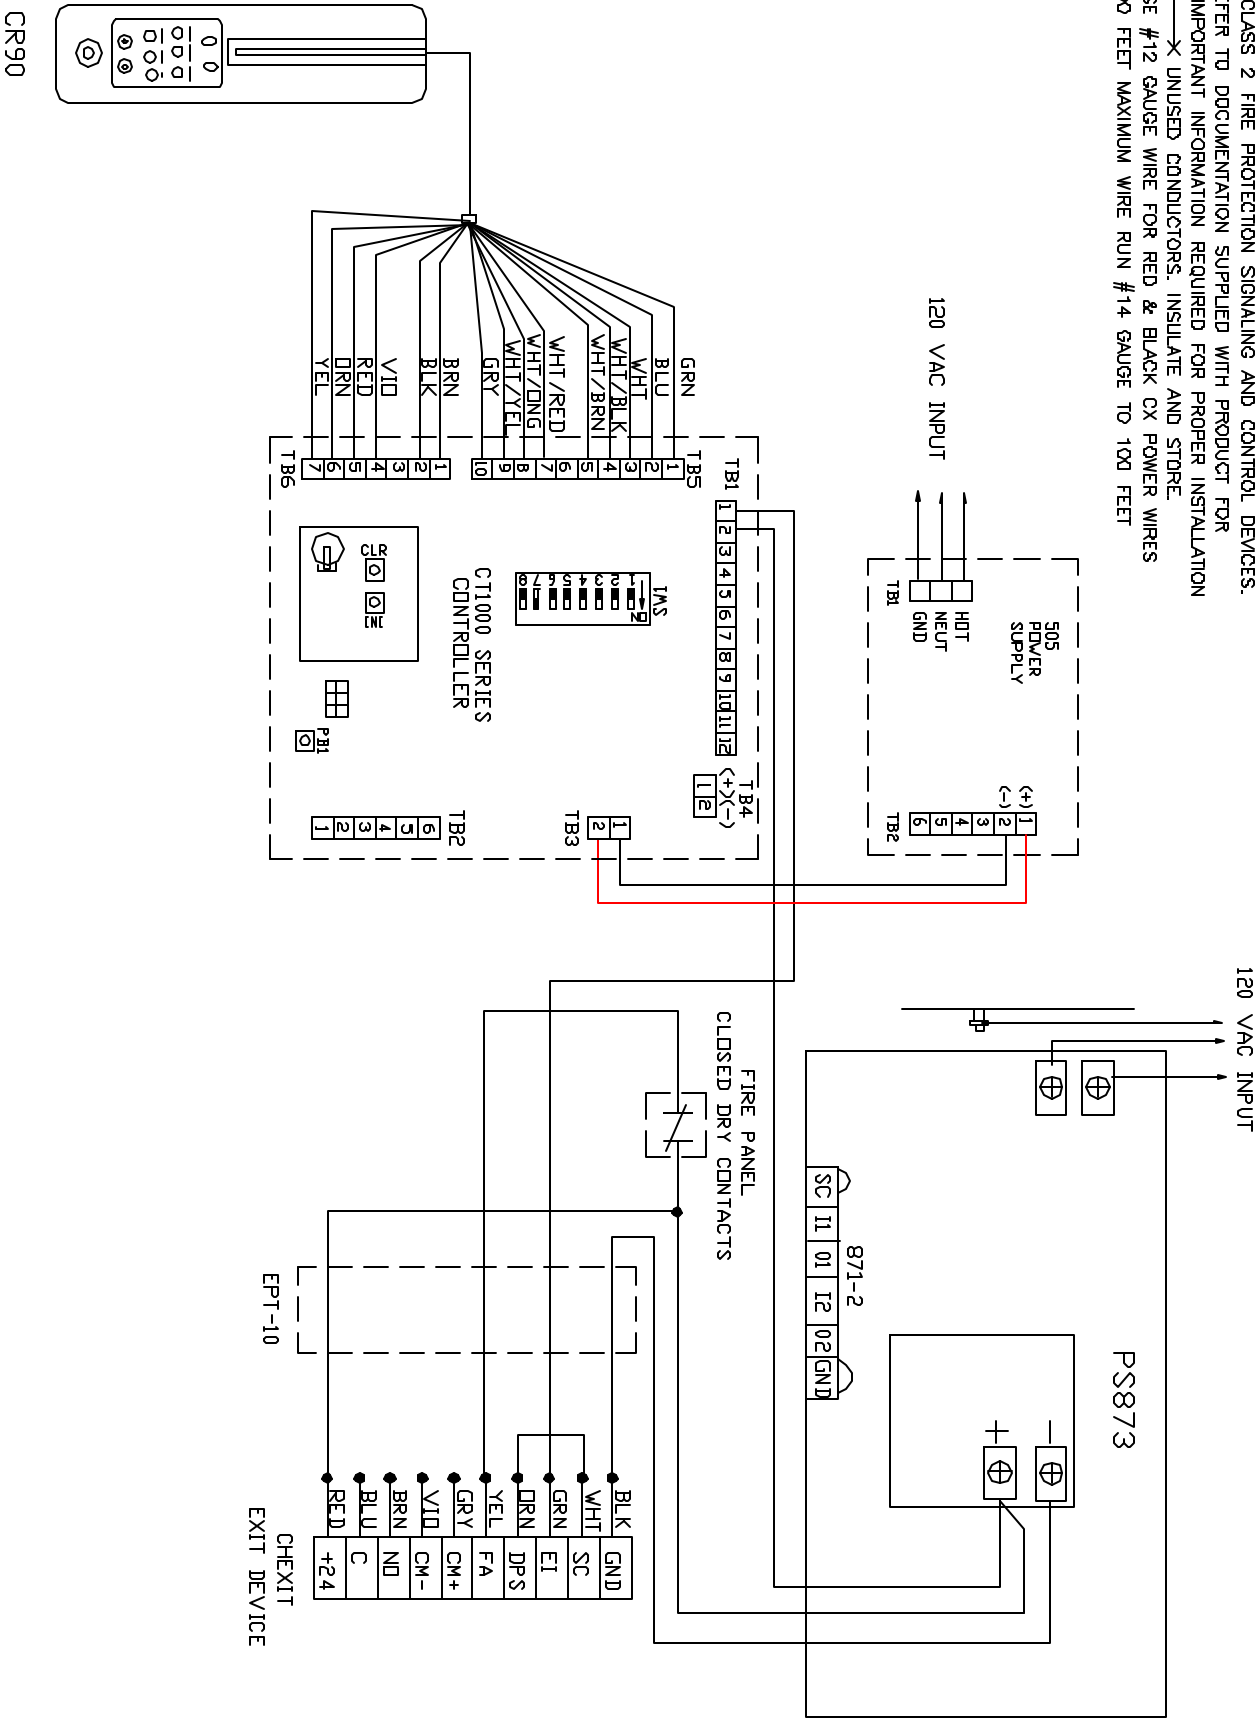

CR90